


Waterrongput XII

Heerentals.

Onderneming: 688

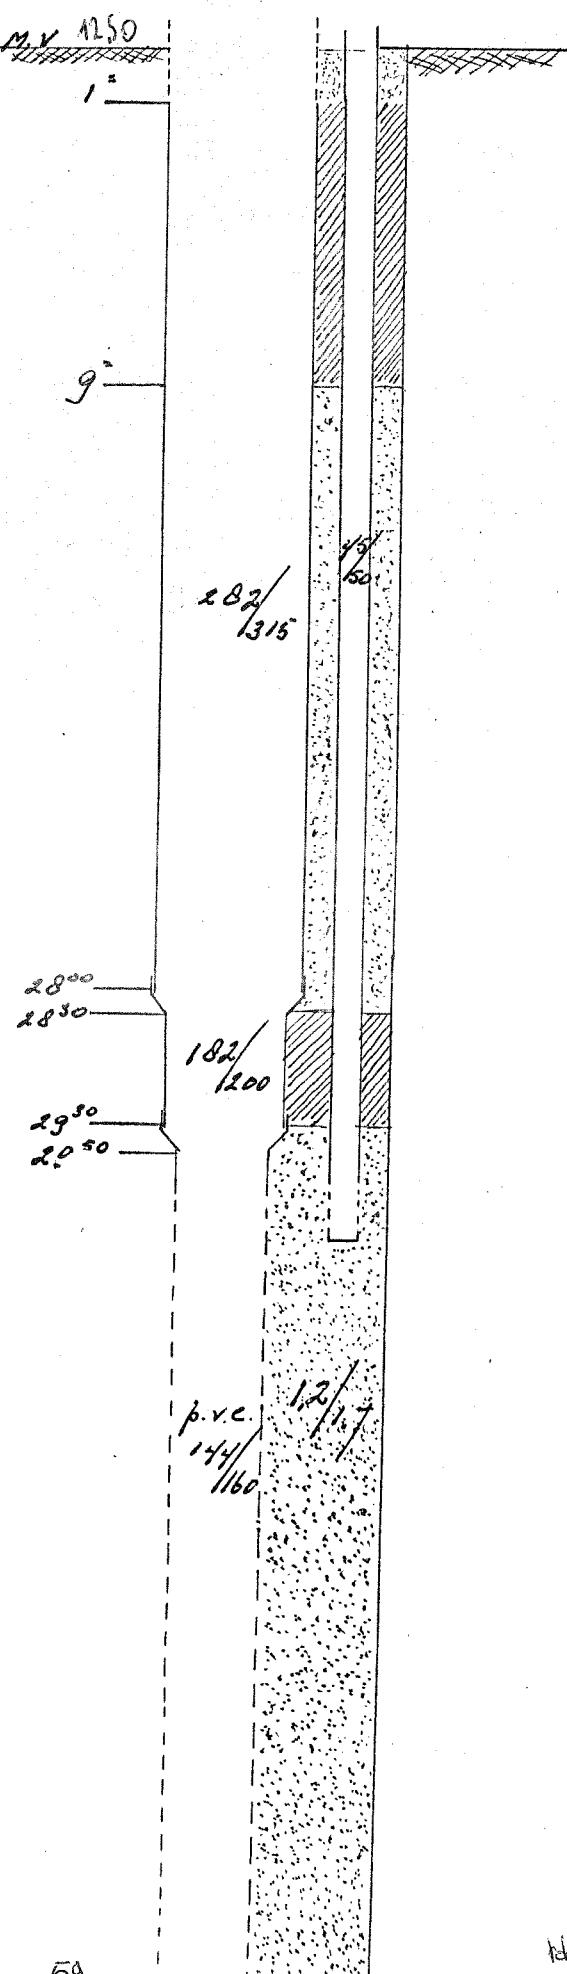

Boordiam. 600 mm.

Boordiepte: 63 m. = m.v.

Omstorting: 15.000. kg. 12/1,7

pompproef: 8/10 t/m 10/10 jz.
pompcapaciteit: 72 m³/u.

	pompput	w.m. filter
8/10. rust.	4.15 m + m.v	4.15.
18°	8.90 m + m.v	8.90.
9/10. op°	8.95 m + m.v	8.95.
12°	8.95 m + m.v	8.95.
18°	8.97 m + m.v	8.97.
10/10 op°	8.98 m + m.v	8.98.
11°	8.98 m + m.v	8.98.

15 min. Na stopzetten pomp.

Water niveau 4.40 m + m.v.

Cap: 72 m³/u. Afstroming: 4.83. m.

Debit: $\frac{72}{4.83} = 14.9 \text{ m}^3/\text{meter afstroming}$.